



WESTERN ELECTRO - ACOUSTIC LABORATORY

A division of Veneklasen Associates, Inc.

T E S T I N G • C A L I B R A T I O N • R E S E A R C H

25132 Rye Canyon Loop Santa Clarita, California 91355 Tel: (661) 775-3741 Fax: (661) 775-3742 www.weal.com

SOUND TRANSMISSION LOSS TEST REPORT NO. TL06-402

CLIENT: International Materials Corporation (Intermat)
2045 Placentia Avenue
Costa Mesa, CA 92627

Page 1 of 2
19 October 2006

TEST DATE: 18 October 2005

INTRODUCTION

The methods and procedures used for this test conform to the provisions and requirements of ASTM E 90-04, *Standard Test Method for Laboratory Measurement of Airborne Sound Transmission Loss of Building Partitions*. Copies of the test standard are available at www.astm.org. The test chamber source and receiving room volumes are 204 and 148.4 cubic meters respectively. Western Electro-Acoustic Laboratory is accredited by NVLAP (National Voluntary Laboratory Accreditation Program) Lab Code 100256-0 for this test procedure. NVLAP is part of the United States Department of Commerce, National Institute of Standards and Technology (NIST). This test report relates only to the item(s) tested. Any advertising that utilizes this test report or test data must not imply product certification or endorsement by WEAL, NVLAP, NIST or the U.S. Government.


DESCRIPTION OF TEST SPECIMEN

The test specimen was a wall assembly constructed from metal studs, Intermat Series 200 Sure-Board, and 5/8 inch (15.9mm) thick type X drywall. The metal studs were Cemco 16 gauge 6 inch (152 mm) by 1-1/4 inch (31.8 mm) and were spaced horizontally at 16 inches (406 mm) O.C. The sill and head tracks were Cemco 16 gauge 6 inch (152 mm) by 1-1/4 inch (31.8 mm). The sill and head track and edge studs were isolated from the test opening with 1/4 inch (6.4 mm) neoprene pads. On the source room side, 5/8 inch (15.9 mm) thick Intermat Series 200 Sure-Board was screwed to the studs with 1-5/8" #8 self tapping screws at 4 inches (102 mm) O.C. at the perimeter and 12 inches (305 mm) O.C. in the field. The Sure-Board was oriented vertically. The panel edges and joints were caulked and sealed with metal foil tape. The screw heads were covered with metal foil tape. On the receiving room side, 5/8 inch (15.9 mm) thick type X drywall was screwed to the studs 1-5/8" drywall screws at 8 inches (203 mm) O.C. at the perimeter and 12 inches (305 mm) O.C. in the field. The drywall was oriented vertically. The panel edges and joints were caulked and sealed with metal foil tape. The screw heads were covered with metal foil tape. Nominal 6 inch (152 mm) thick Johns Manville R-19 kraft faced sound control fiberglass insulation was installed in the stud space. The overall dimensions of the wall assembly were 12 feet (3.66 m) wide by 96 inches (2.44 m) high by 7-1/4 inches (184 mm) thick. The overall weight of the assembly was estimated to be 841 lbs. (381 kg) for a calculated surface density of 8.76 lbs./ft² (42.8 kg/m²).

RESULTS OF THE MEASUREMENTS

One-third octave band sound transmission loss values are plotted and tabulated on the attached sheet. ASTM minimum volume requirements are met at 80 Hz and above. The Sound Transmission Class rating determined in accordance with ASTM E 413-04 was STC-47.


Respectfully submitted,
Western Electro-Acoustic Laboratory


Gary E. Marje
Laboratory Director



WESTERN ELECTRO-ACOUSTIC LABORATORY

Report No. TL06-402

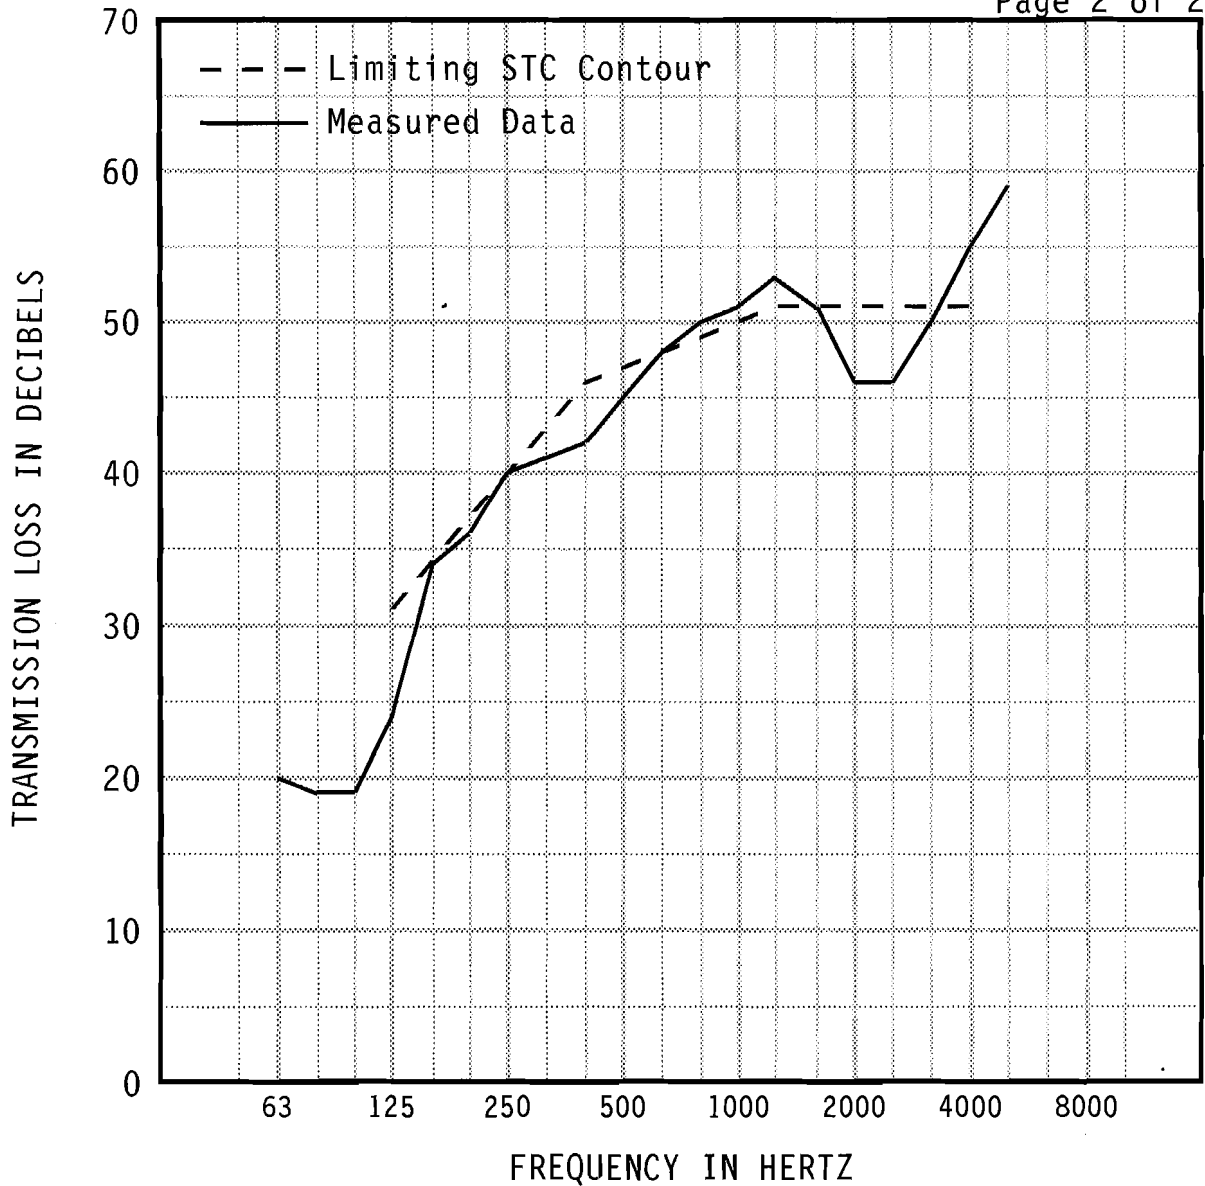

1/3 OCT BND CNTR FREQ	63	80	100	125	160	200	250	315	400	500
TL in dB	20	19	19	24	34	36	40	41	42	45
95% Confidence in dB deficiencies	1.42	1.92	2.07	1.47 (7)	0.89 (0)	0.76 (1)	0.80 (0)	0.52 (2)	0.36 (4)	0.38 (2)
1/3 OCT BND CNTR FREQ	630	800	1000	1250	1600	2000	2500	3150	4000	5000
TL in dB	48	50	51	53	51	46	46	50	55	59
95% Confidence in dB deficiencies	0.29 (0)	0.44	0.38	0.39	0.36 (0)	0.56 (5)	0.55 (5)	0.31 (1)	0.32	0.50

EWR	OITC	Specimen Area: 96 sq.ft. Temperature: 73.8 deg. F Relative Humidity: 43 % Test Date: 18 October 2006	STC
47	33		47
			(27)

Report must be distributed in its entirety except with written authorization from Western Electro-Acoustic Laboratory

